



## TRANSFORMER SPECIFICATION

- 3 Phase Drive Isolation
- Dry Type
- ANN Self Cooled
- Suitable for Nonsinusoidal Current Load with a K-Factor not to exceed 4

Purchaser: TBA  
 PO#: TBA  
 SWO#: TBA  
 Qty: TBA

**Preliminary Drawing ONLY**

This drawing may NOT truly reflect our final design. Any resulting order(s) must be accompanied by or refer to this drawing and be marked with any proposed changes

Coils: Aluminum  
 Cat. No.: DA11X-P/FE  
 RPN#: DA11HCB-P/X/FE

Windings	For Cable Size	Termination
Primary @ Front	#18 AWG up to #8 AWG	Terminal Blocks
Secondary @ Front	#18 AWG up to #8 AWG	Terminal Blocks

kVA: 11  
 Primary: 480/240/208 Delta Volts  
 Secondary: 480 Y/277 Volts

### Wiring Connection:

**Primary:**  
 Voltage 480 Jumpers To: 1-1-1 Connect Lines To: H1-H2-H3  
 240 2-2-2 H1-H2-H3  
 208 3-3-3 H1-H2-H3



Secondary Taps: 5 %  
 -Taps FCAN 1  
 -Taps FCBN 1

**Secondary:**  
 Voltage 480 % Tap 105.0  
 504Y/291 100.0  
 480Y/277 95.0  
 456Y/263


Frequency: 60 Hz

BIL: 10 kV  
 Insulation Class: 220 °C  
 Temperature Rise: 150 °C  
 Impedance: 4.0 - 5.0 %

Weight: 195 Lbs

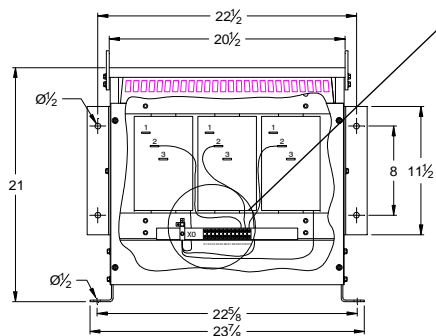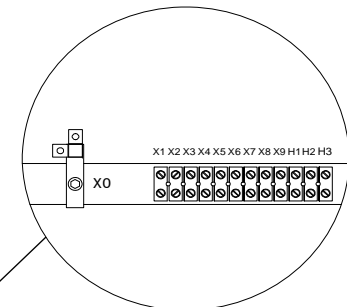

FRONT VIEW

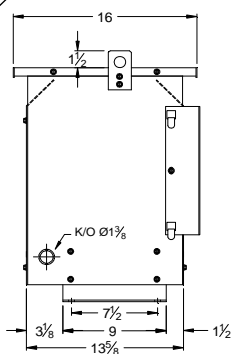

SIDE VIEW

### Standards:


- 1)- CSA Certified File No. LR34493
- 2)- UL Listed File No. E108255

### Standard Features:

- 1)- Anti-vibration pads installed between the enclosure base and the core & coil assembly
- 2)- Lug for Earth grounding provided
- 3)- Neutral rated 200% of the line terminals
- 4)- N/C 200°C thermostat installed at the centre coil
- 5)- Seismic rated for USA zone 4 and Canada zone 6

### Special Features:

X = ± 5% F.C. Secondary taps



**Note:** Secondary is fully rated - only one can be used at a time

### CSA Enclosure:

- 1)- Type 3R (NEMA 3R)
  - Sprinklerproof when the angle between sprinkler heads and opening in the enclosure does not exceed 45 degree from the vertical.
- 2)- Ventilated
- 3)- ASA 61 grey
- 4)- Floor/Wall mounting

1	Terminal Blocks HV/LV & Marking	AP	VS	Aug.1, 2017
Rev.	Remarks	By	Appr. By	Date

Prepared by: AP  
 Approved by: VS  
 Date: MAY 13, 2015